



Certificate of analysis

SFC180-01-01

Operator: Galbha Duggal

Date: 13/08/15

Supervisor: Zam Cader

Date: 12/02/2016



Signature: *Zam Cader*

Source of fibroblasts and reprogramming information

- SF180 from Glostrup Hospital, Denmark
15/08/2014
- Reprogrammed at UOXF WIMM
- Reprogrammed on 17/10/2014 at passage 4
- Cytotune v2 WP3 SOP10


Viability post-thaw and Morphology according to SOP19 passage 17

- Cell count immediately post-thaw 1.34×10^6
- Viability immediately post-thaw 90.5%
- Photo at 24h & day 4 post-thaw (scale bar = $100\mu\text{m}$):

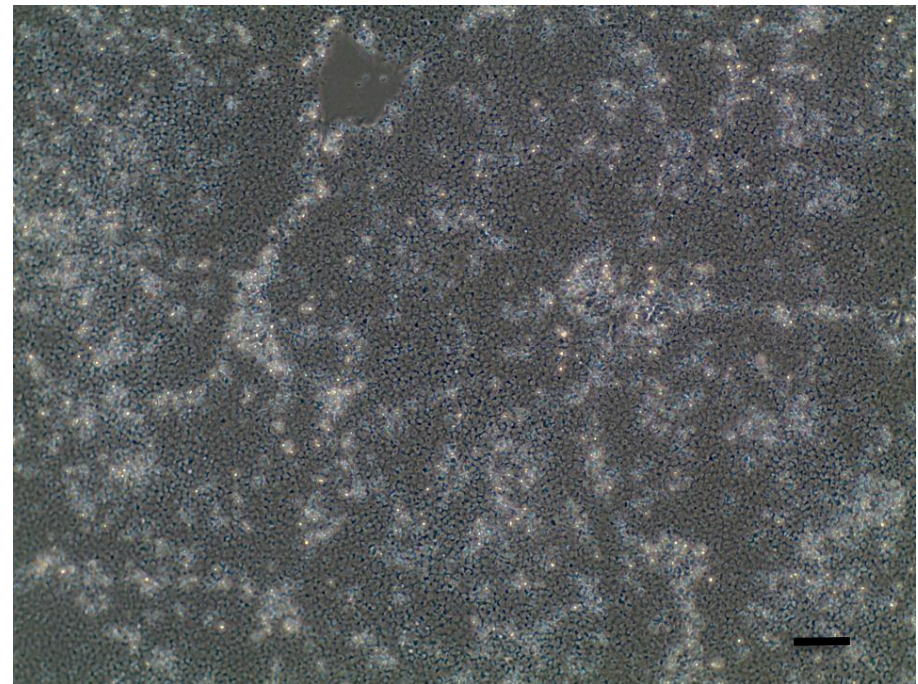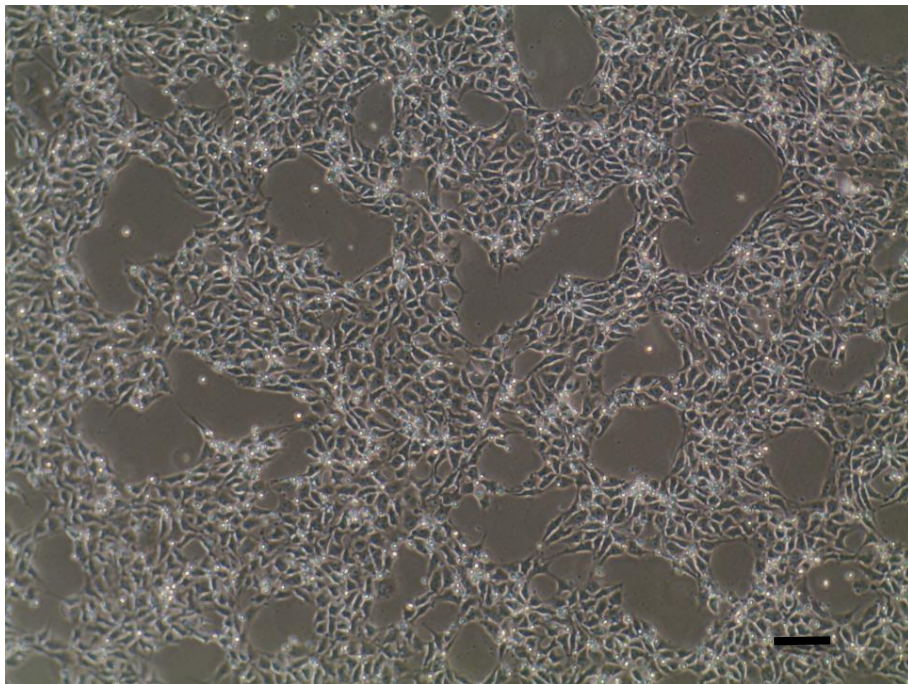

Sendai clearance: according to WP3 SOP15 undetectable at passage 17

100bp ladder
Actin
Sendai Virus
KOS
C-Myc
Klf4
100bp ladder
Actin
Sendai Virus
KOS
C-Myc
Klf4
100bp ladder
Actin
Sendai Virus
KOS
C-Myc
Klf4
100bp ladder
Actin
Sendai Virus
KOS
C-Myc
Klf4
100bp ladder
Actin
Sendai Virus
KOS
C-Myc
Klf4

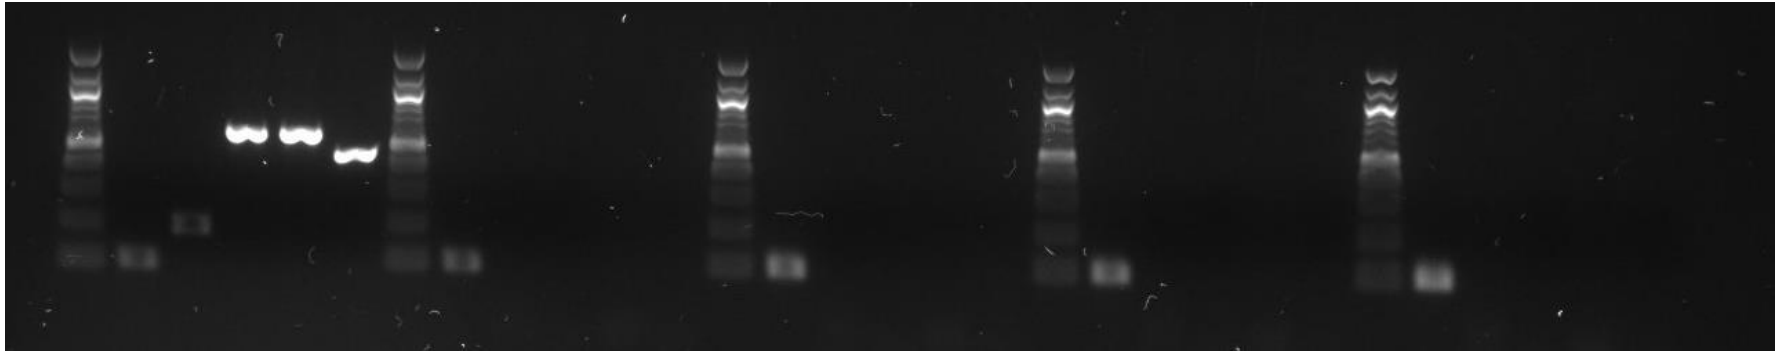

+ control

SFC180-01-01

SFC856-03-07

SFC856-03-08

SFC856-03-04

Product sizes: Actin 92bp; SeV 181bp; SeV KOS 528bp; SeV-Myc 532bp; SeV-Klf 410bp;

Mycoplasma Test:

According to MycoAlert Lonza LT07-318 undetectable at passage 17

Sample	Passage Number	Initials	Reading 1	Reading 2	Ratio/Status
+ ve control			54	5829	107.94
- ve control			105	77	0.73
SFC180-01-01	p17	GD	50	14	0.28

Results:


Ratio **0 - 0.999** negative for mycoplasma

Ratio **1 – 1.3** Borderline Result (retest required)


Ratio above **1.3** positive for mycoplasma

Flow cytometric analysis according to WP3 SOP 20 and 21 passage 17

Tra-1-60:

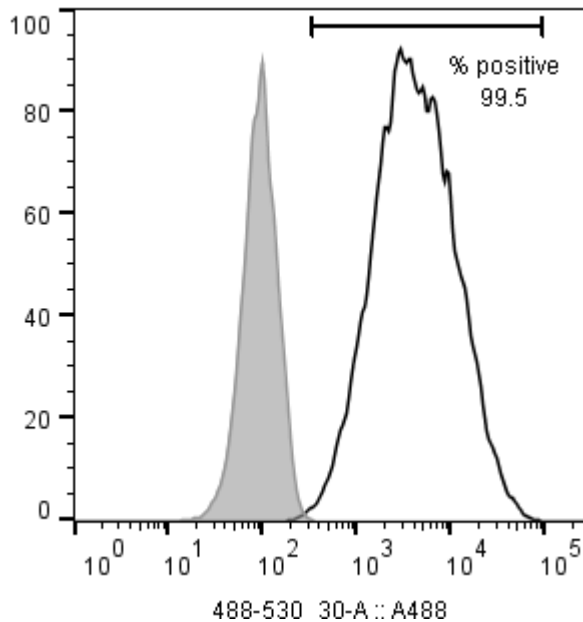

NANOG:

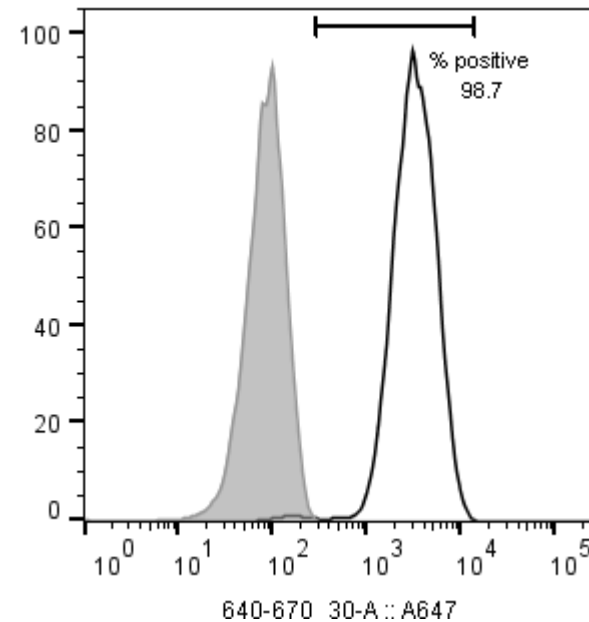

SNP analysis

according to WP3 SOP Preparation of DNA
and RNA samples for Illumina arrays

- Passage 17
- Identity to parent fibroblasts confirmed
- Karyotype abnormalities: none detected
- For details and raw data see StemDB